

Figure 1A
(PRIOR ART)

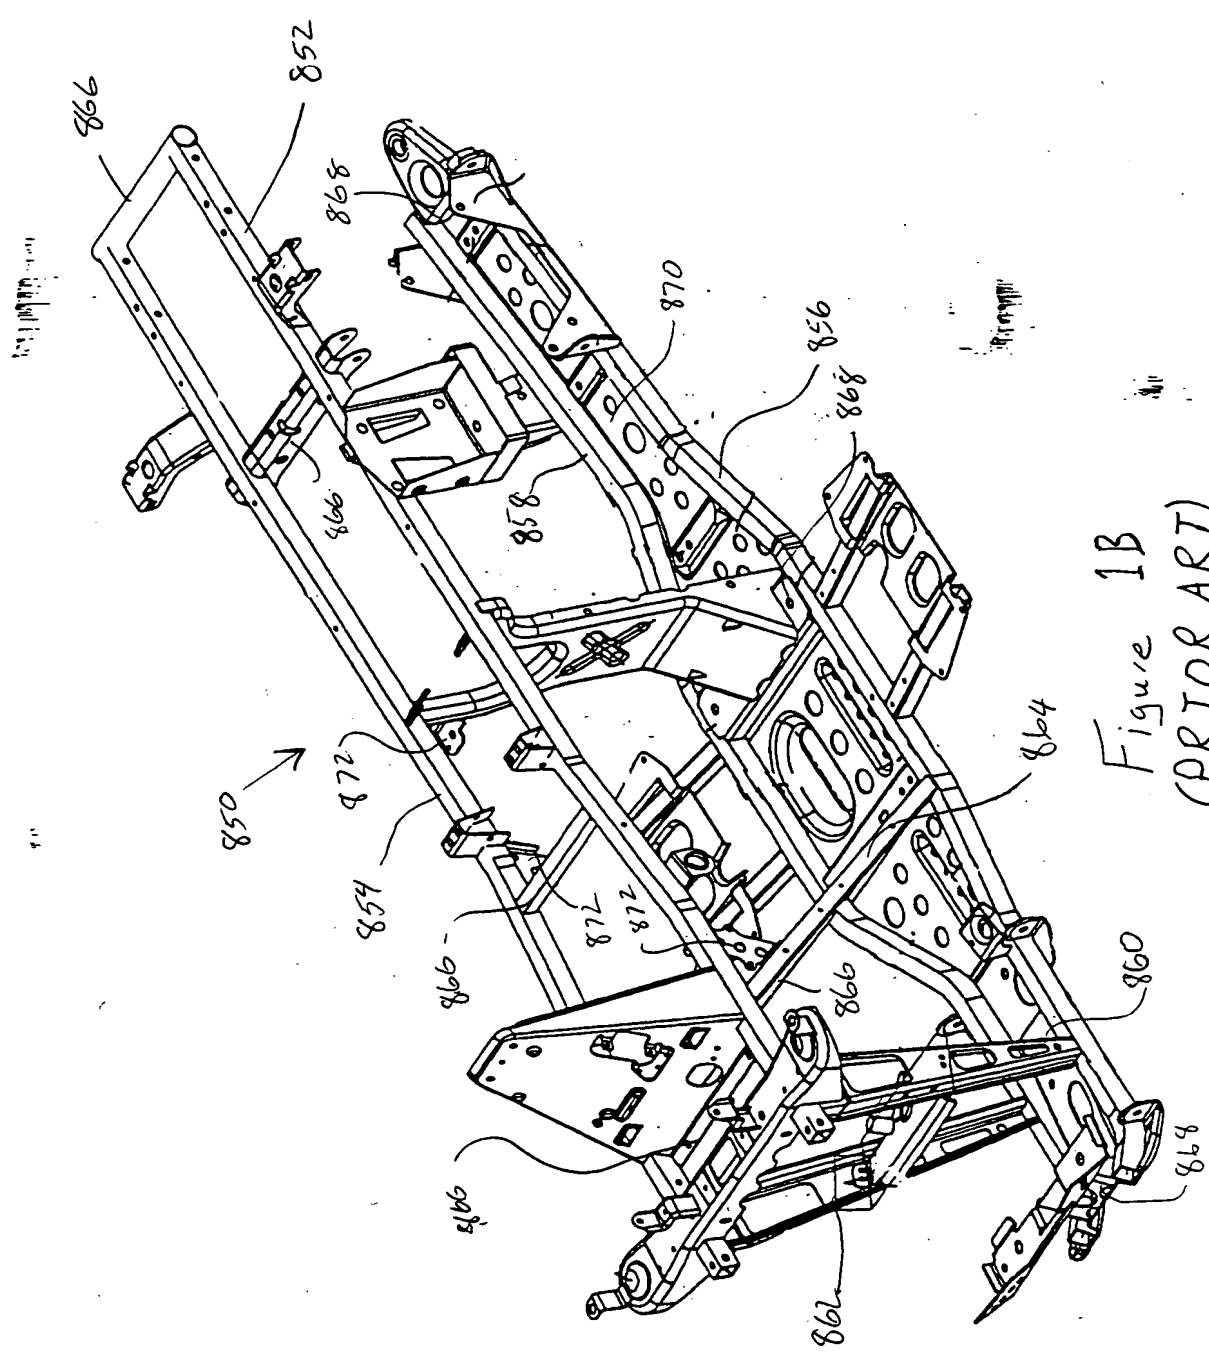
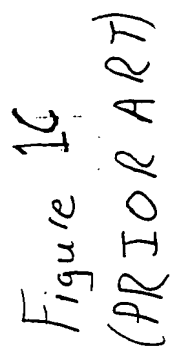


Figure 1B
(PRIOR ART)



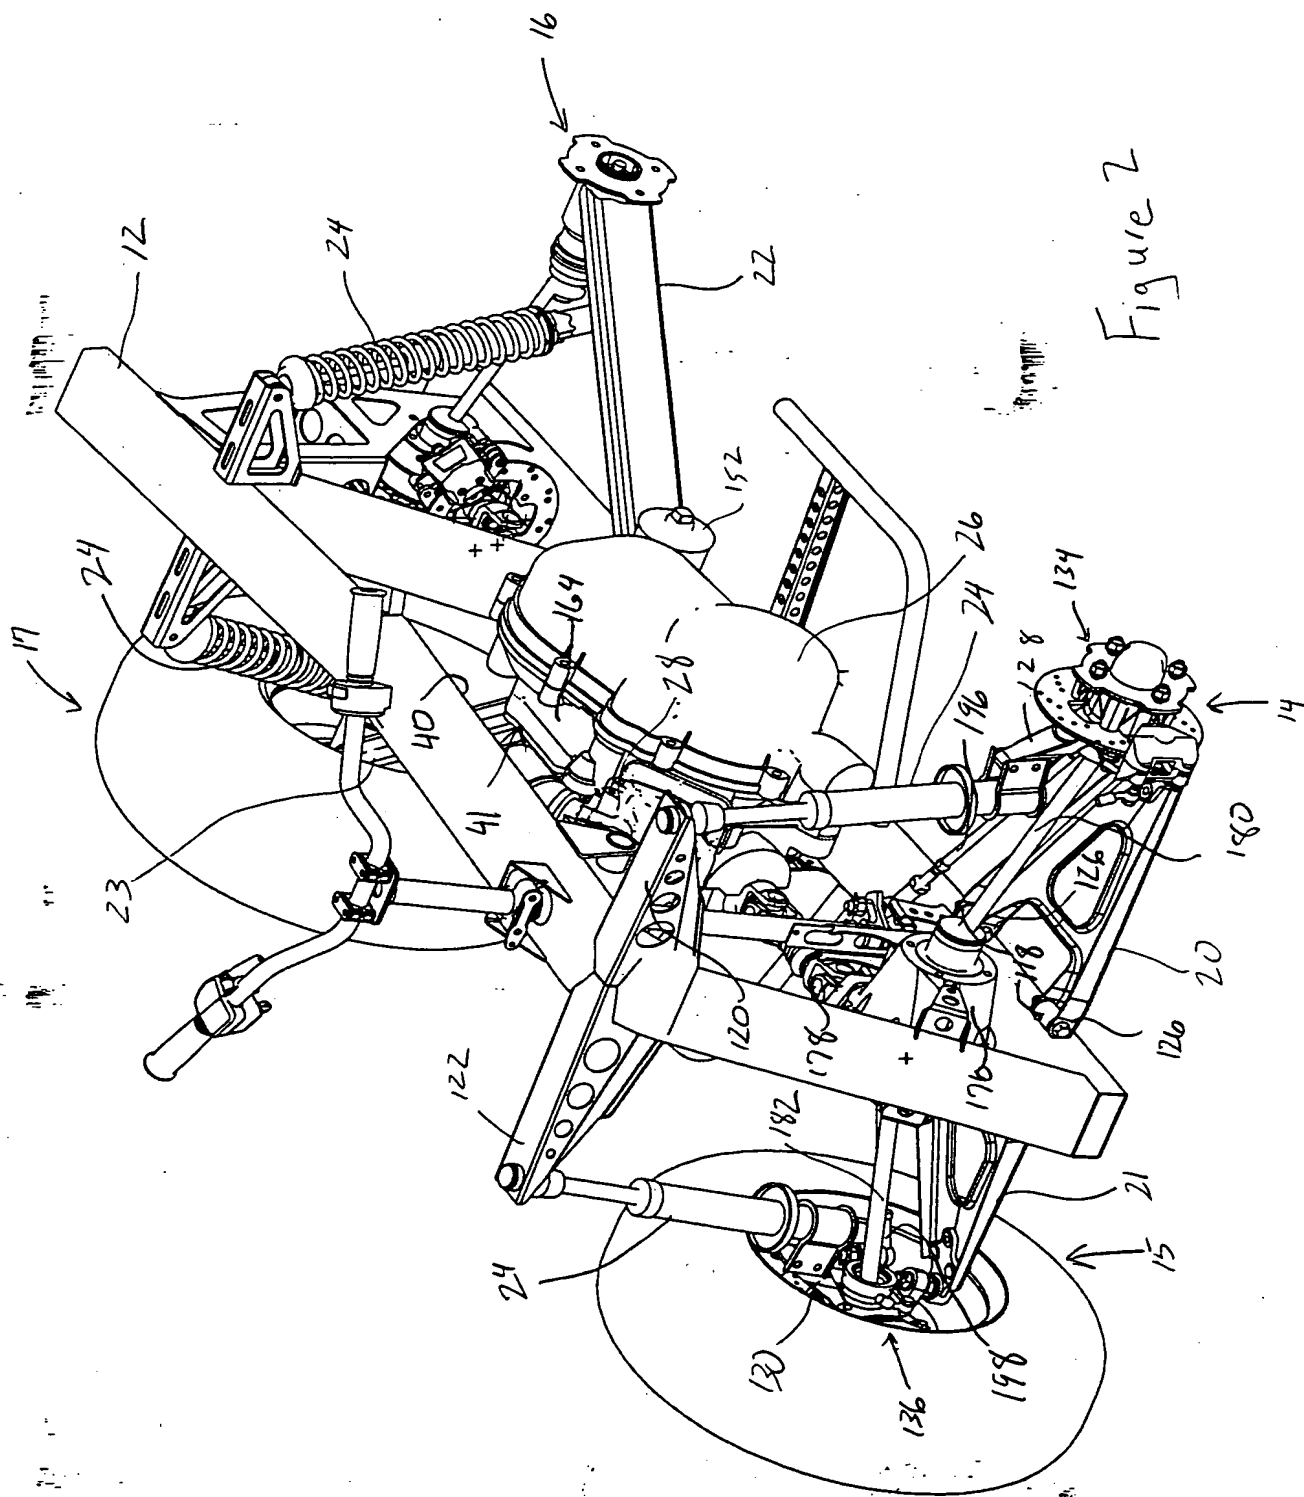
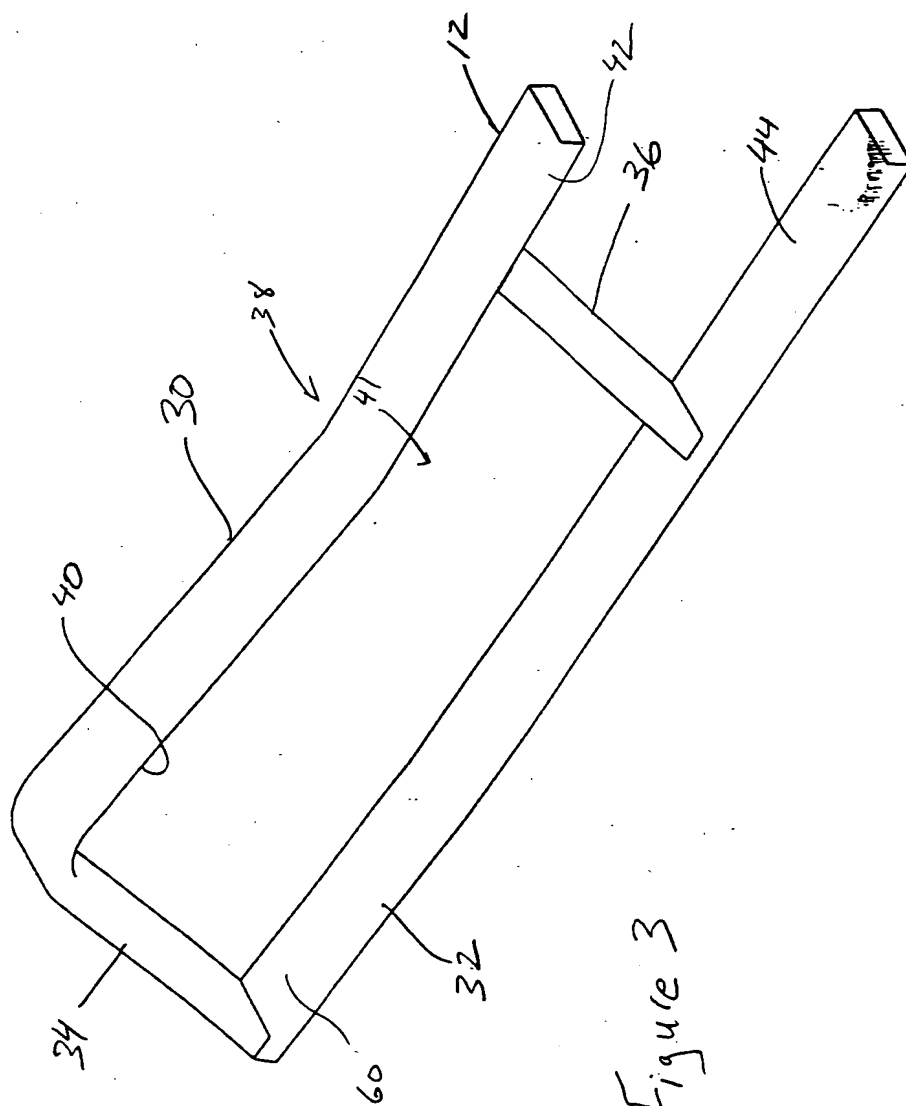


Figure 2



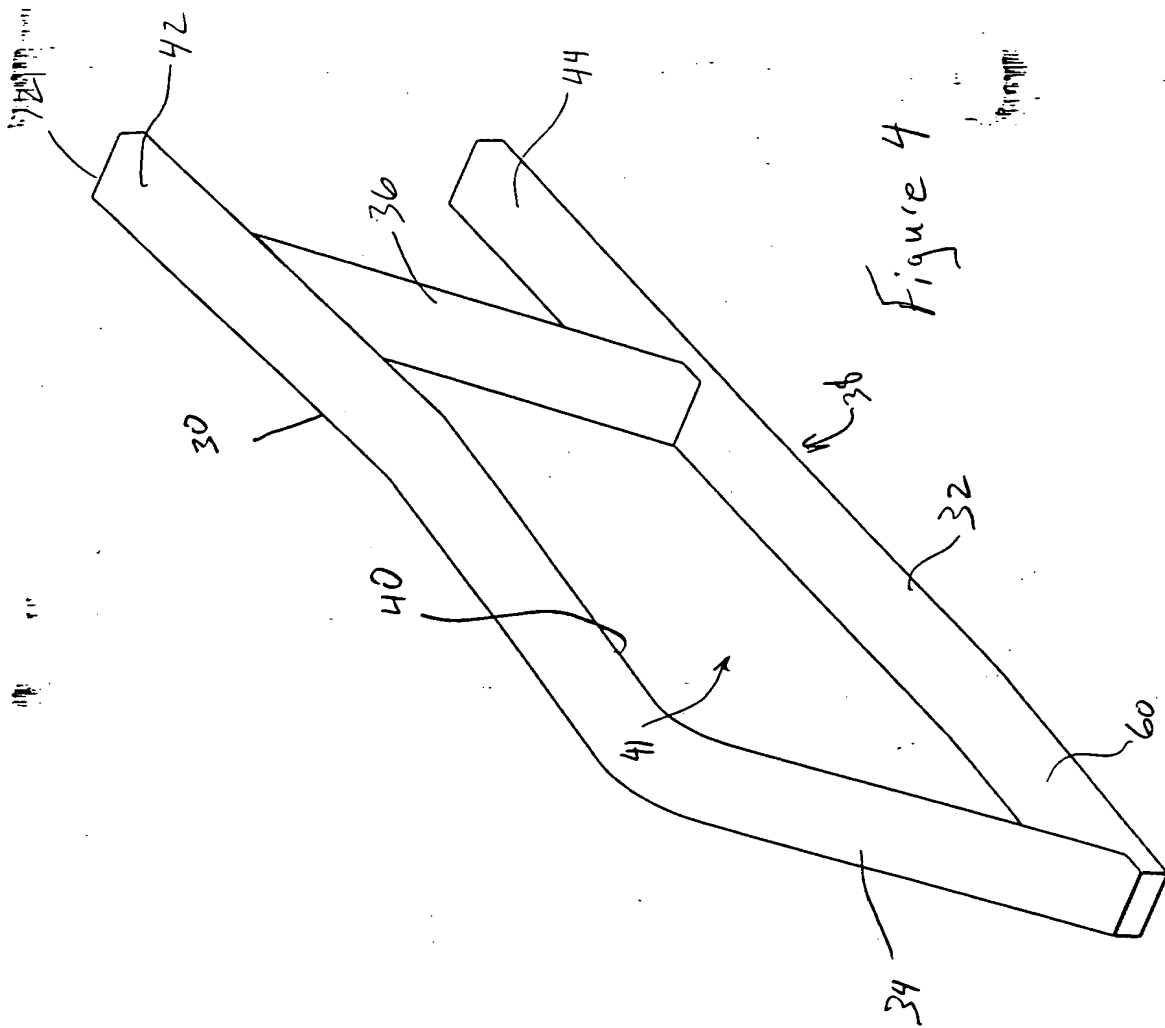


Figure 4

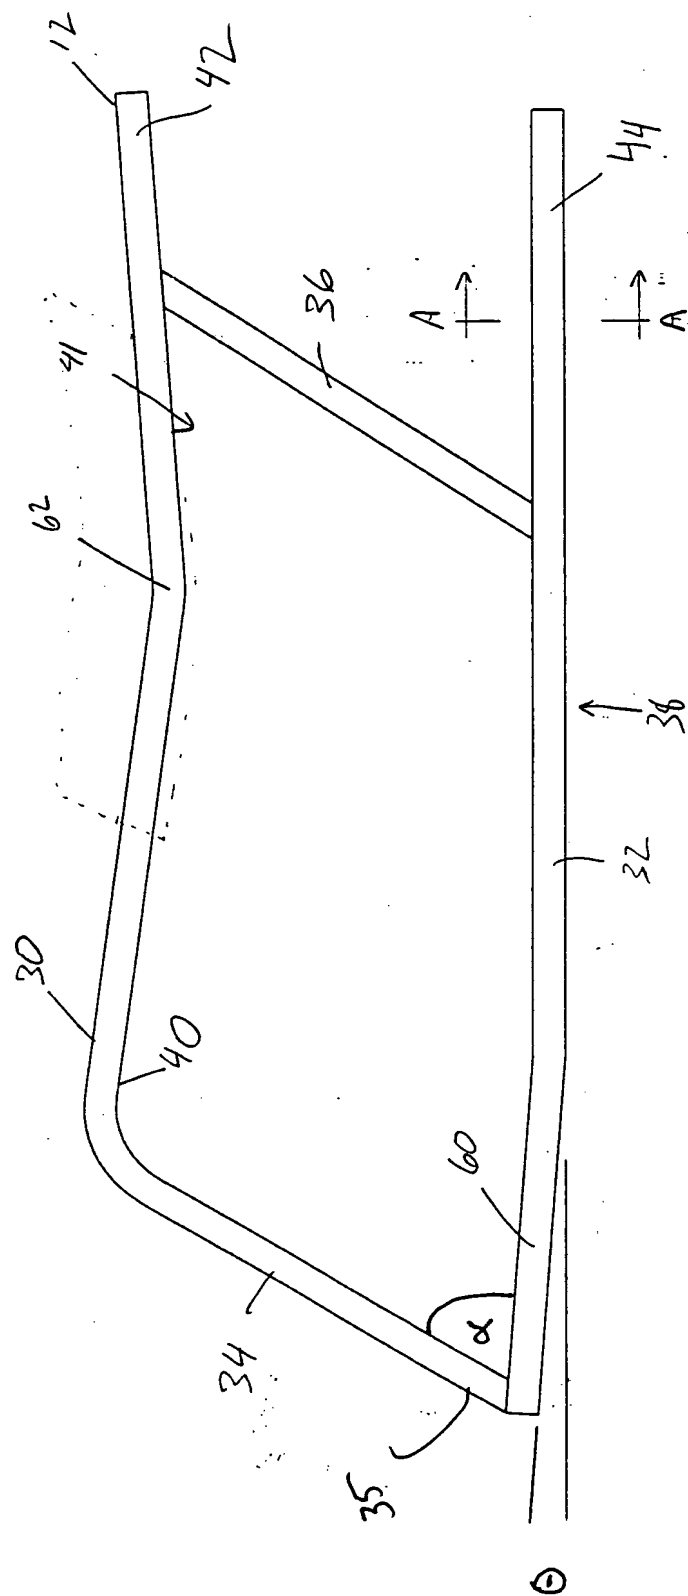


Figure 5

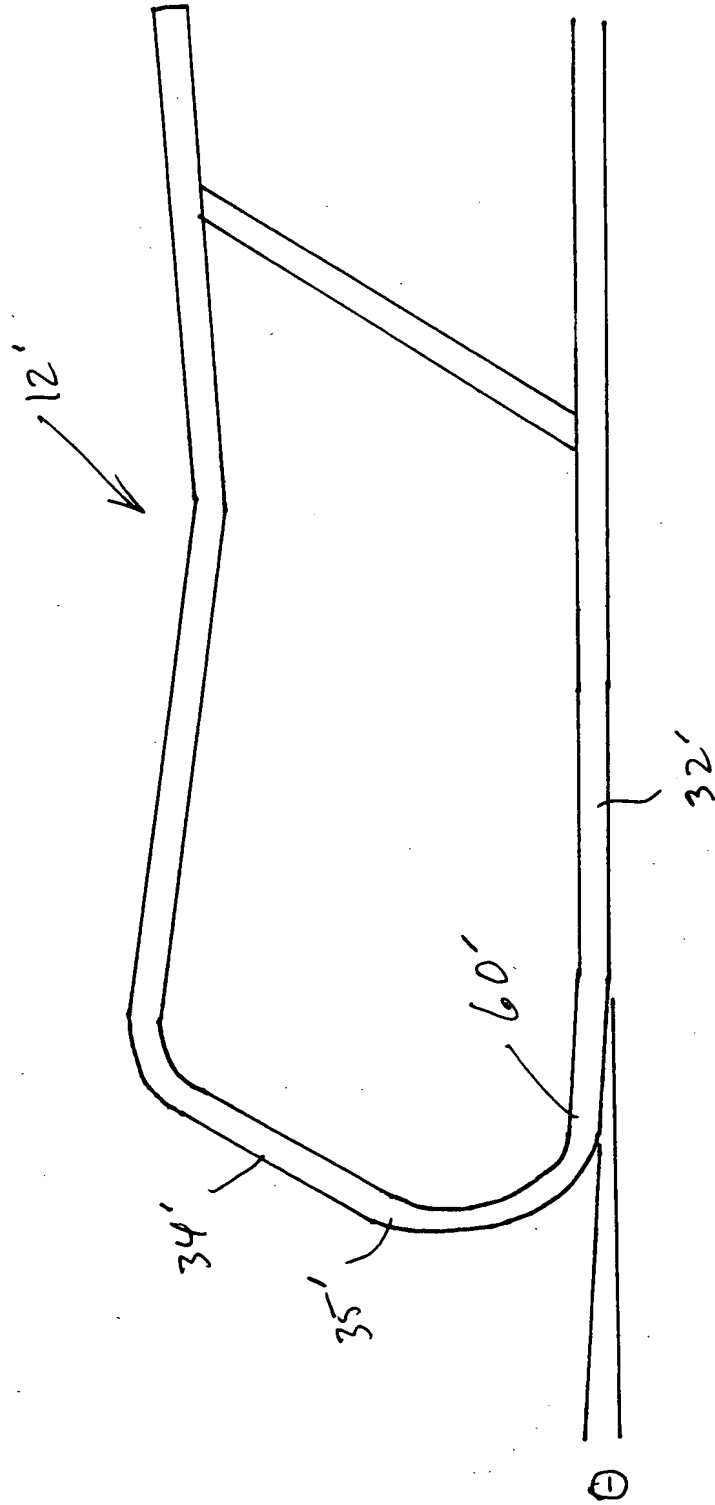


Figure 5A

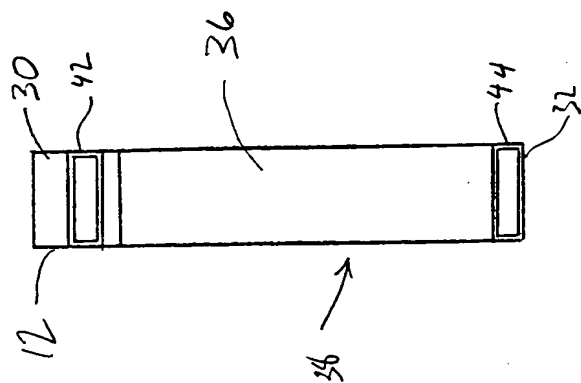


Figure 6

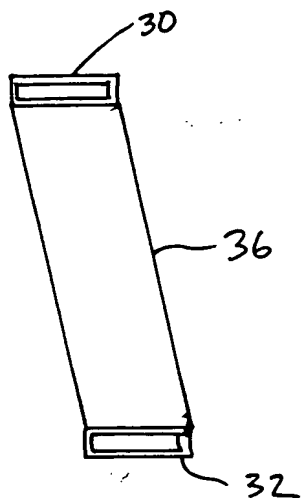


Figure 6A

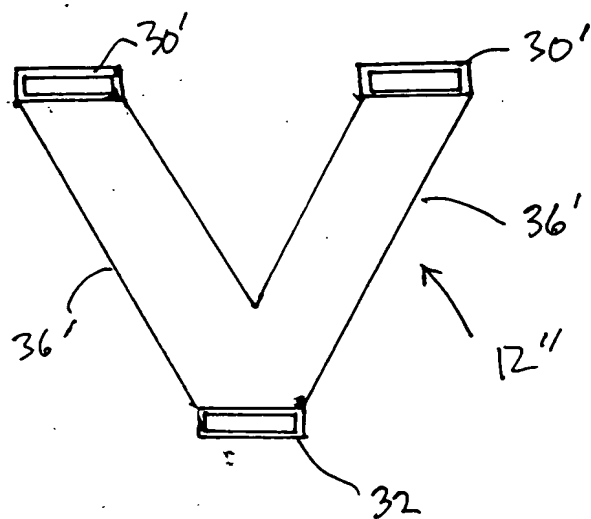


Figure 6C

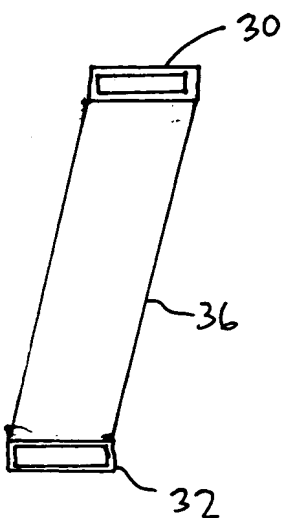


Figure 6B

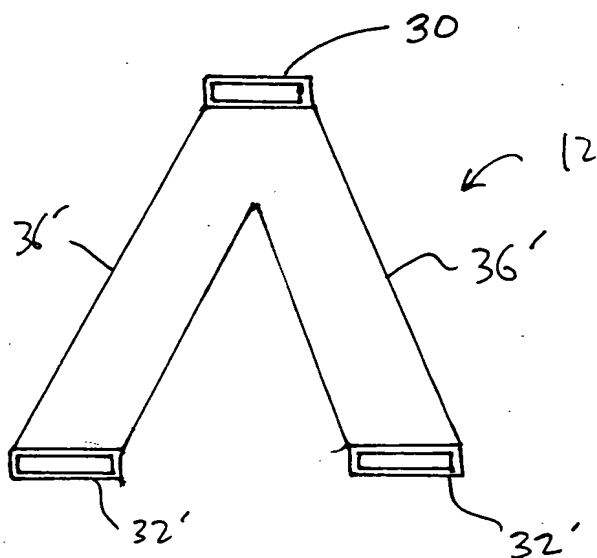


Figure 6D

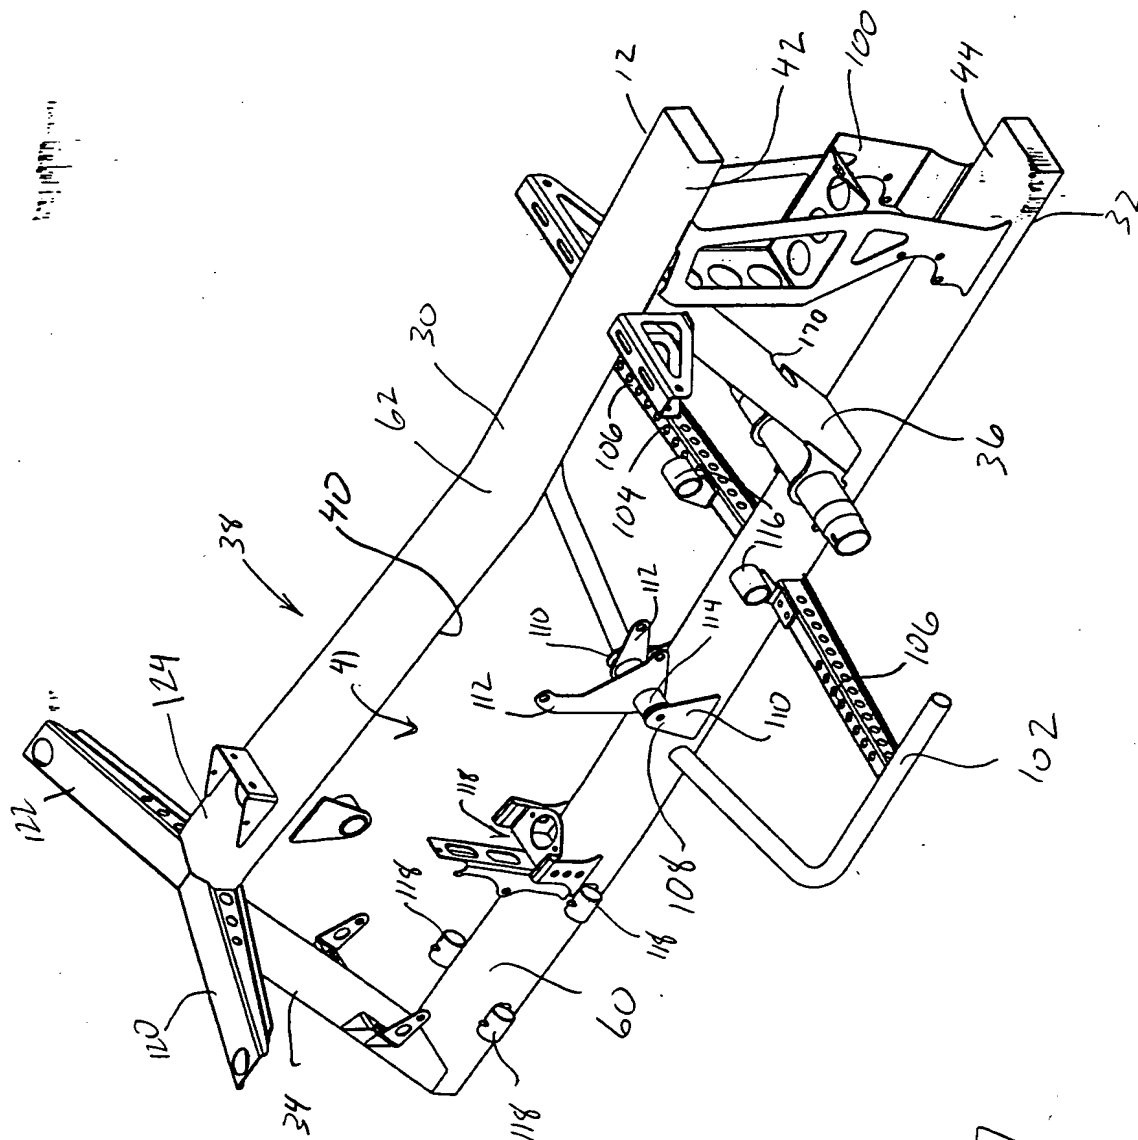


Figure 7

FIG. 8 is a perspective view of the device in a second position, showing the device in a folded position. The device is shown in a folded position, with the handle 34 and the base 100 being folded together. The device is shown in a folded position, with the handle 34 and the base 100 being folded together. The device is shown in a folded position, with the handle 34 and the base 100 being folded together.

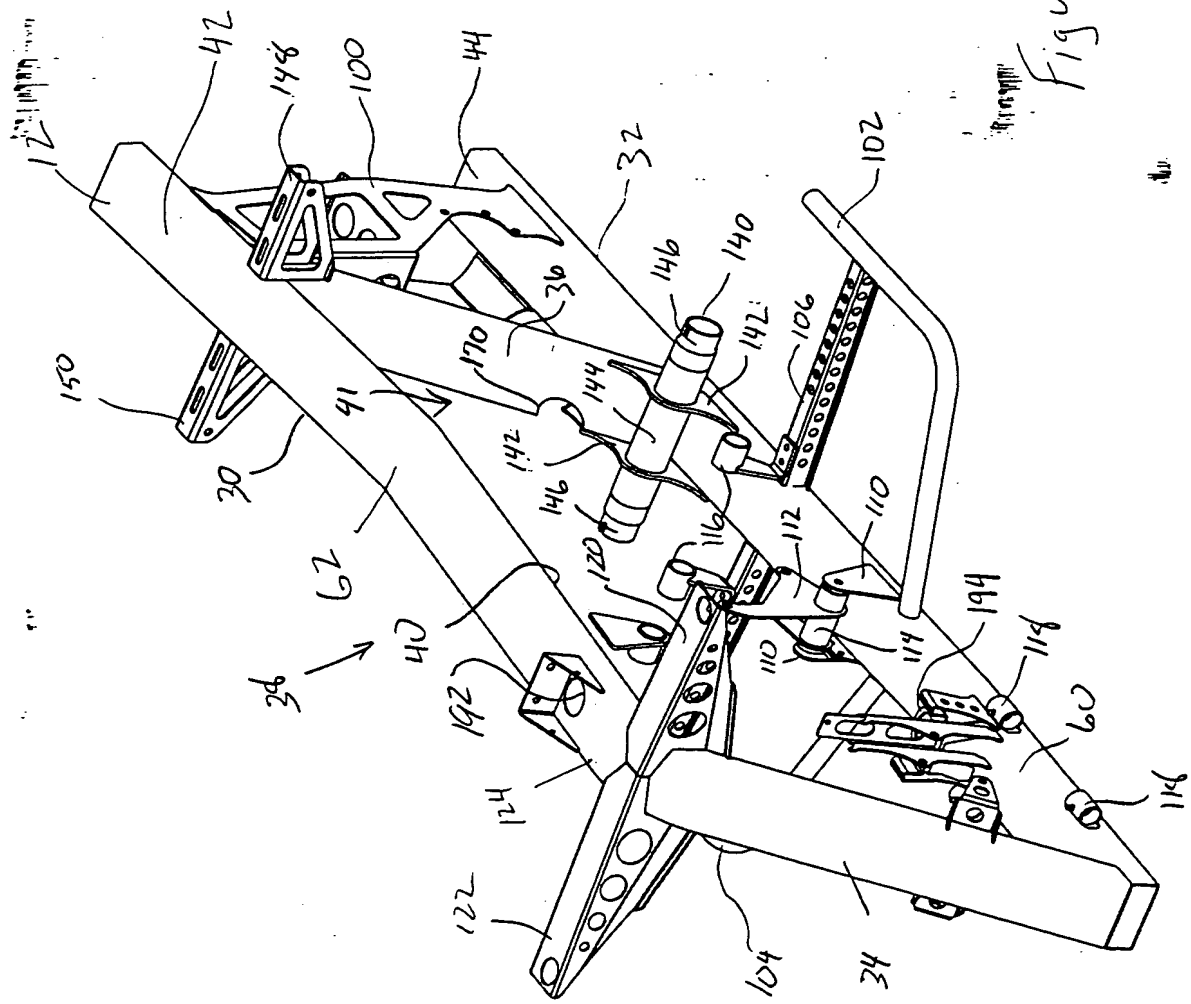


Figure 8

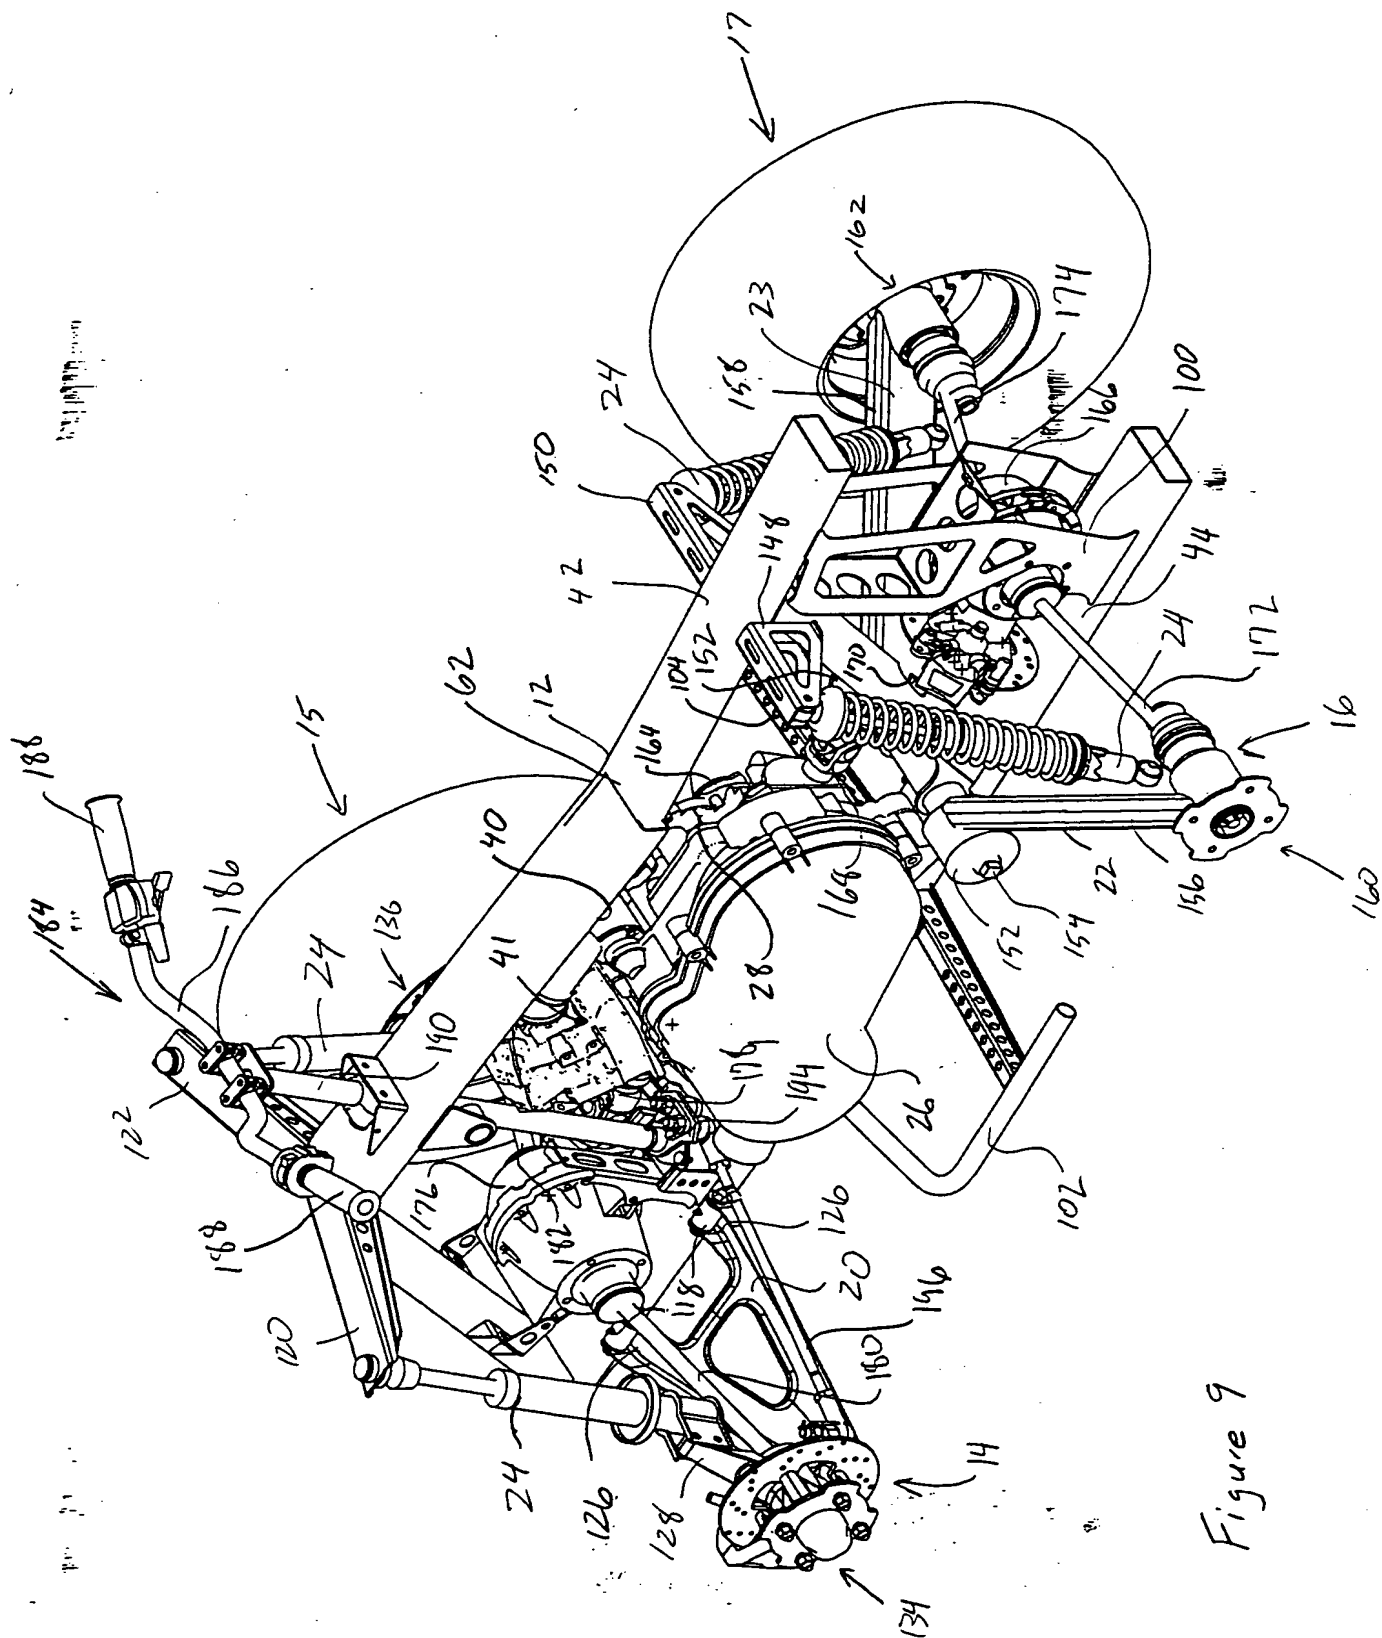


Figure 9

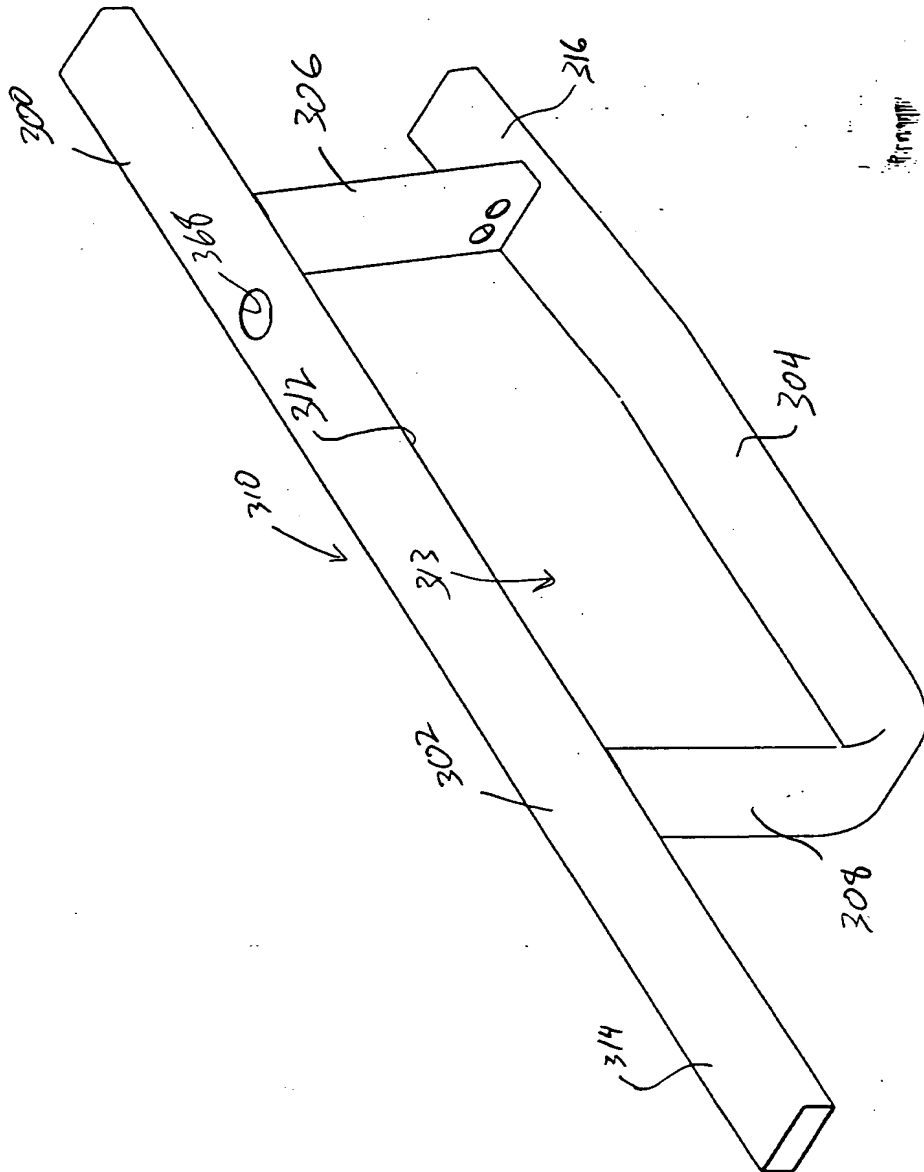


Figure 11

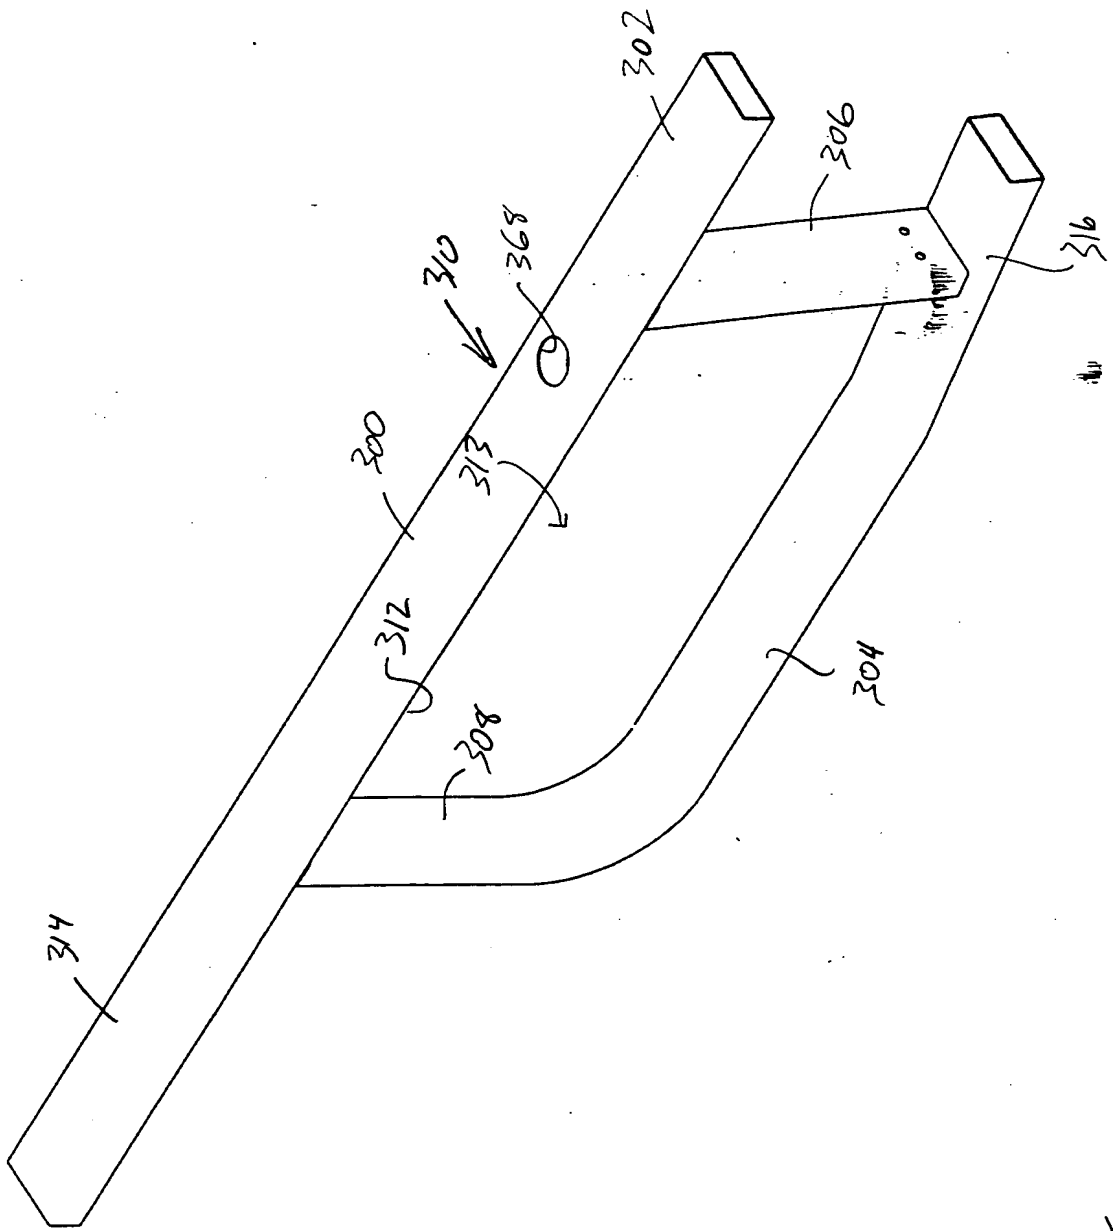


Figure 12

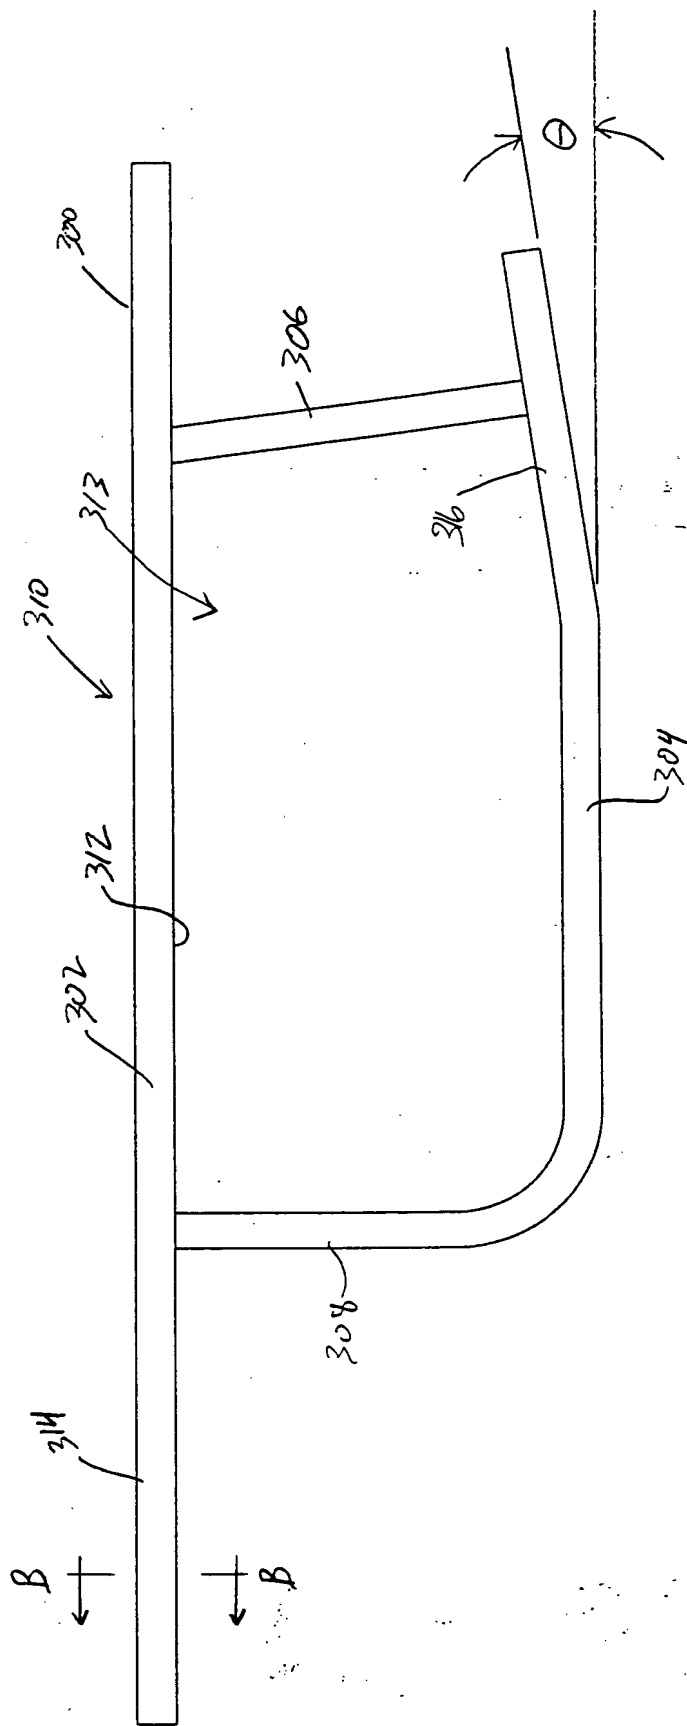
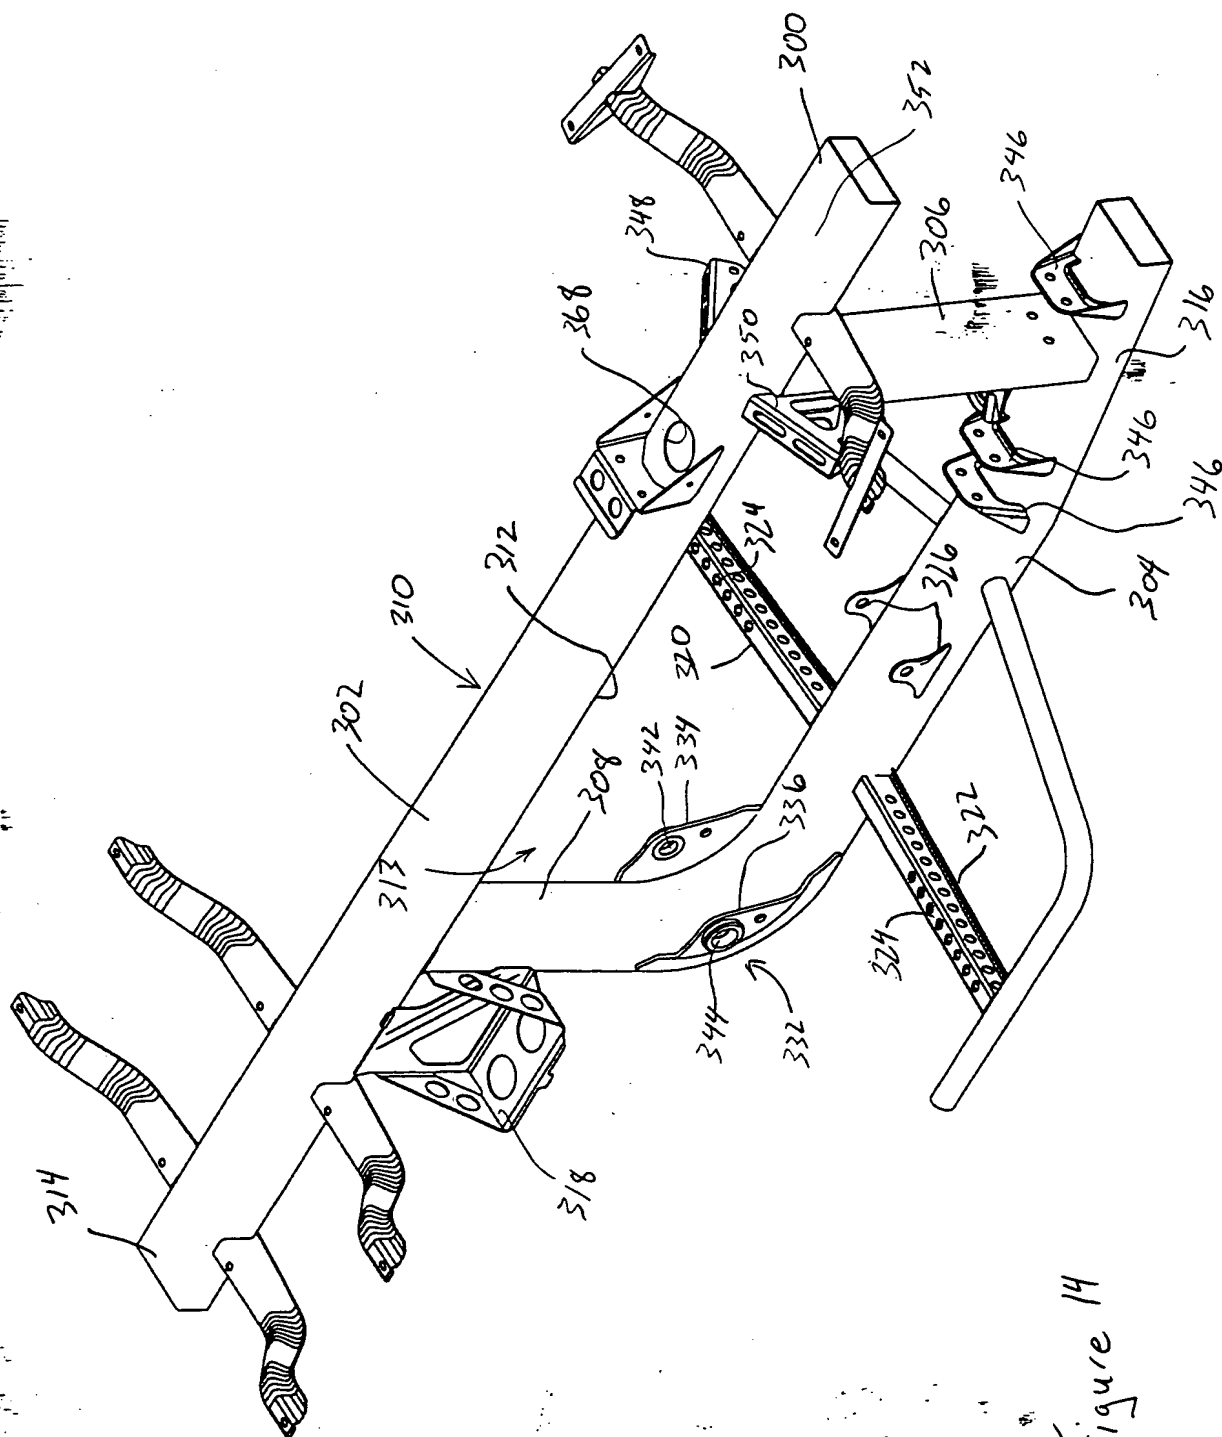


Figure 13



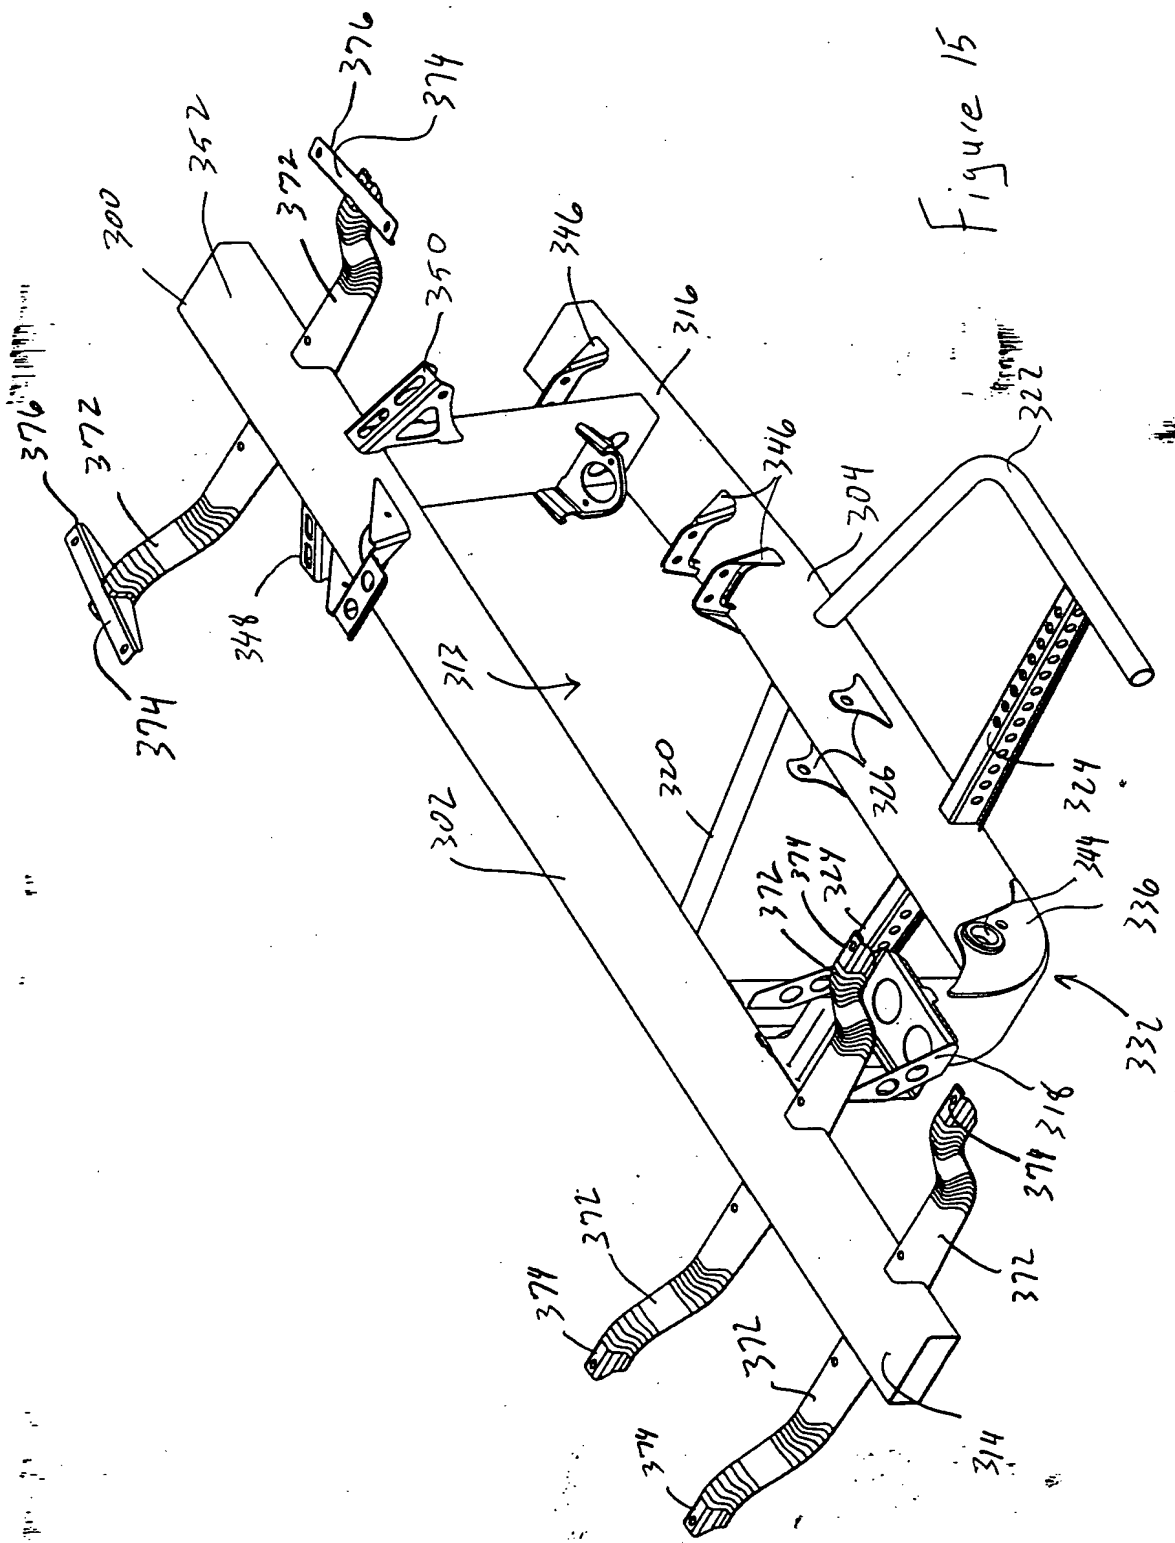


Figure 15

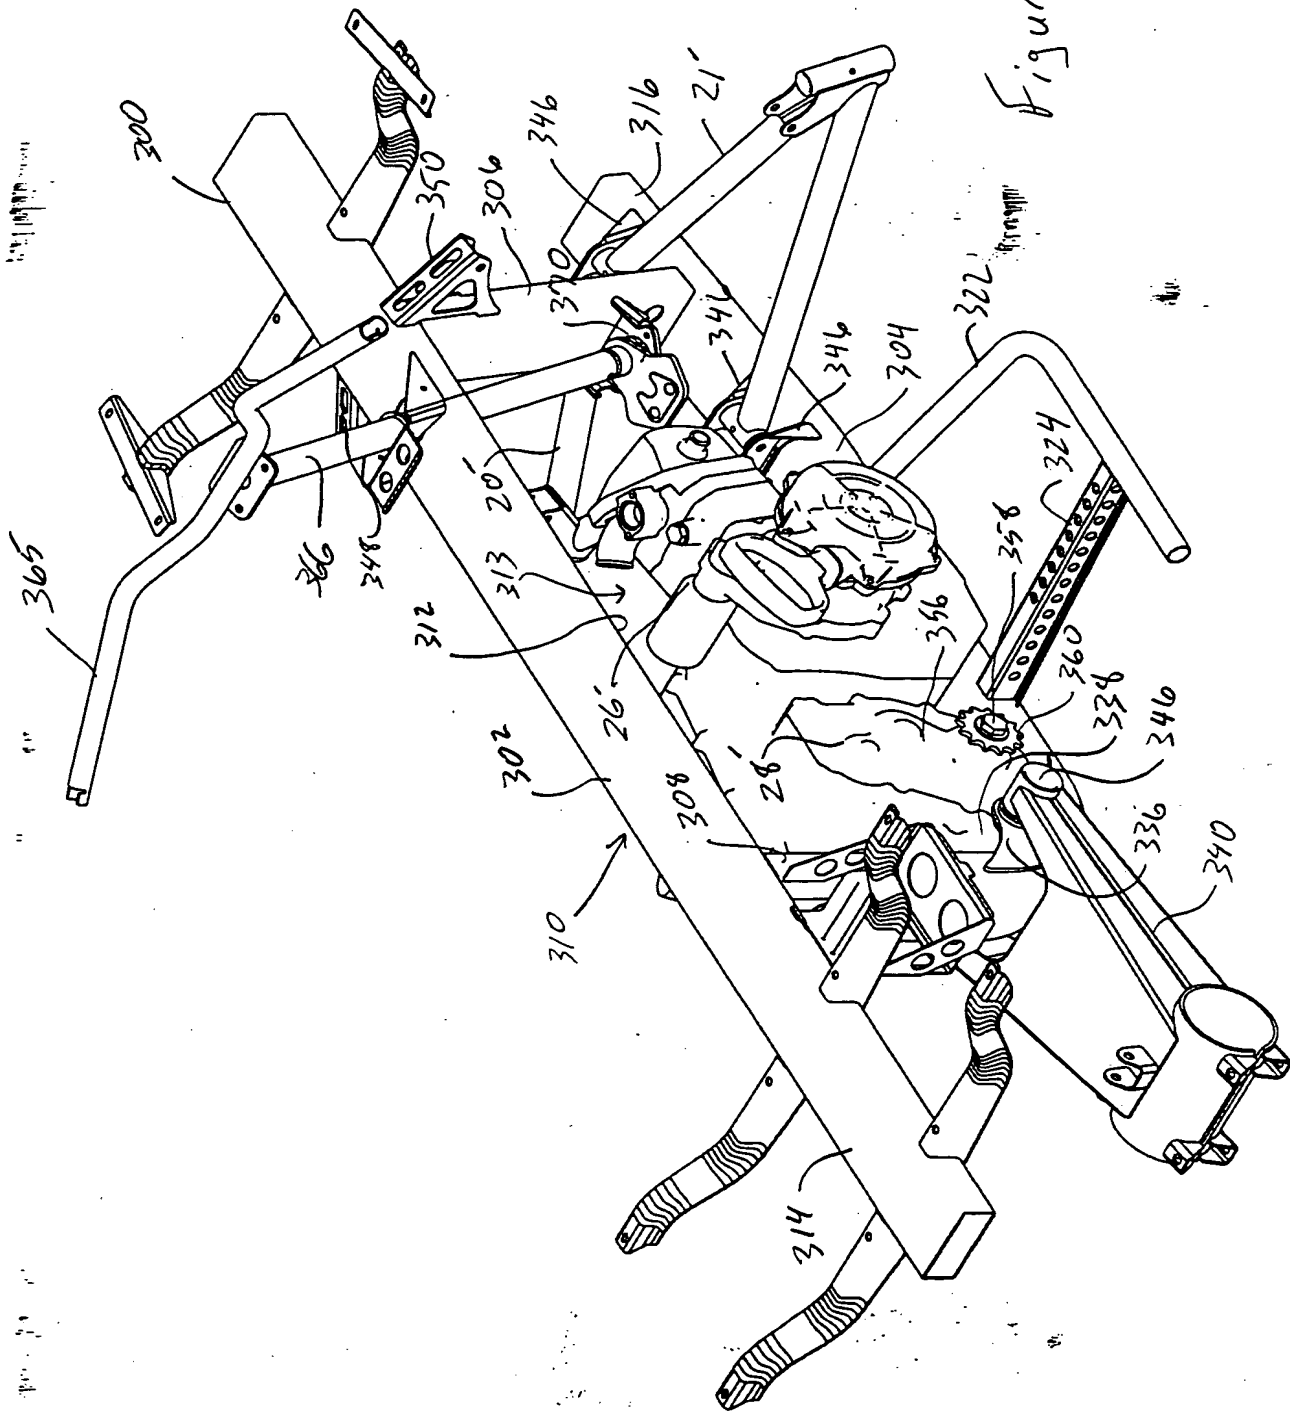


Figure 16

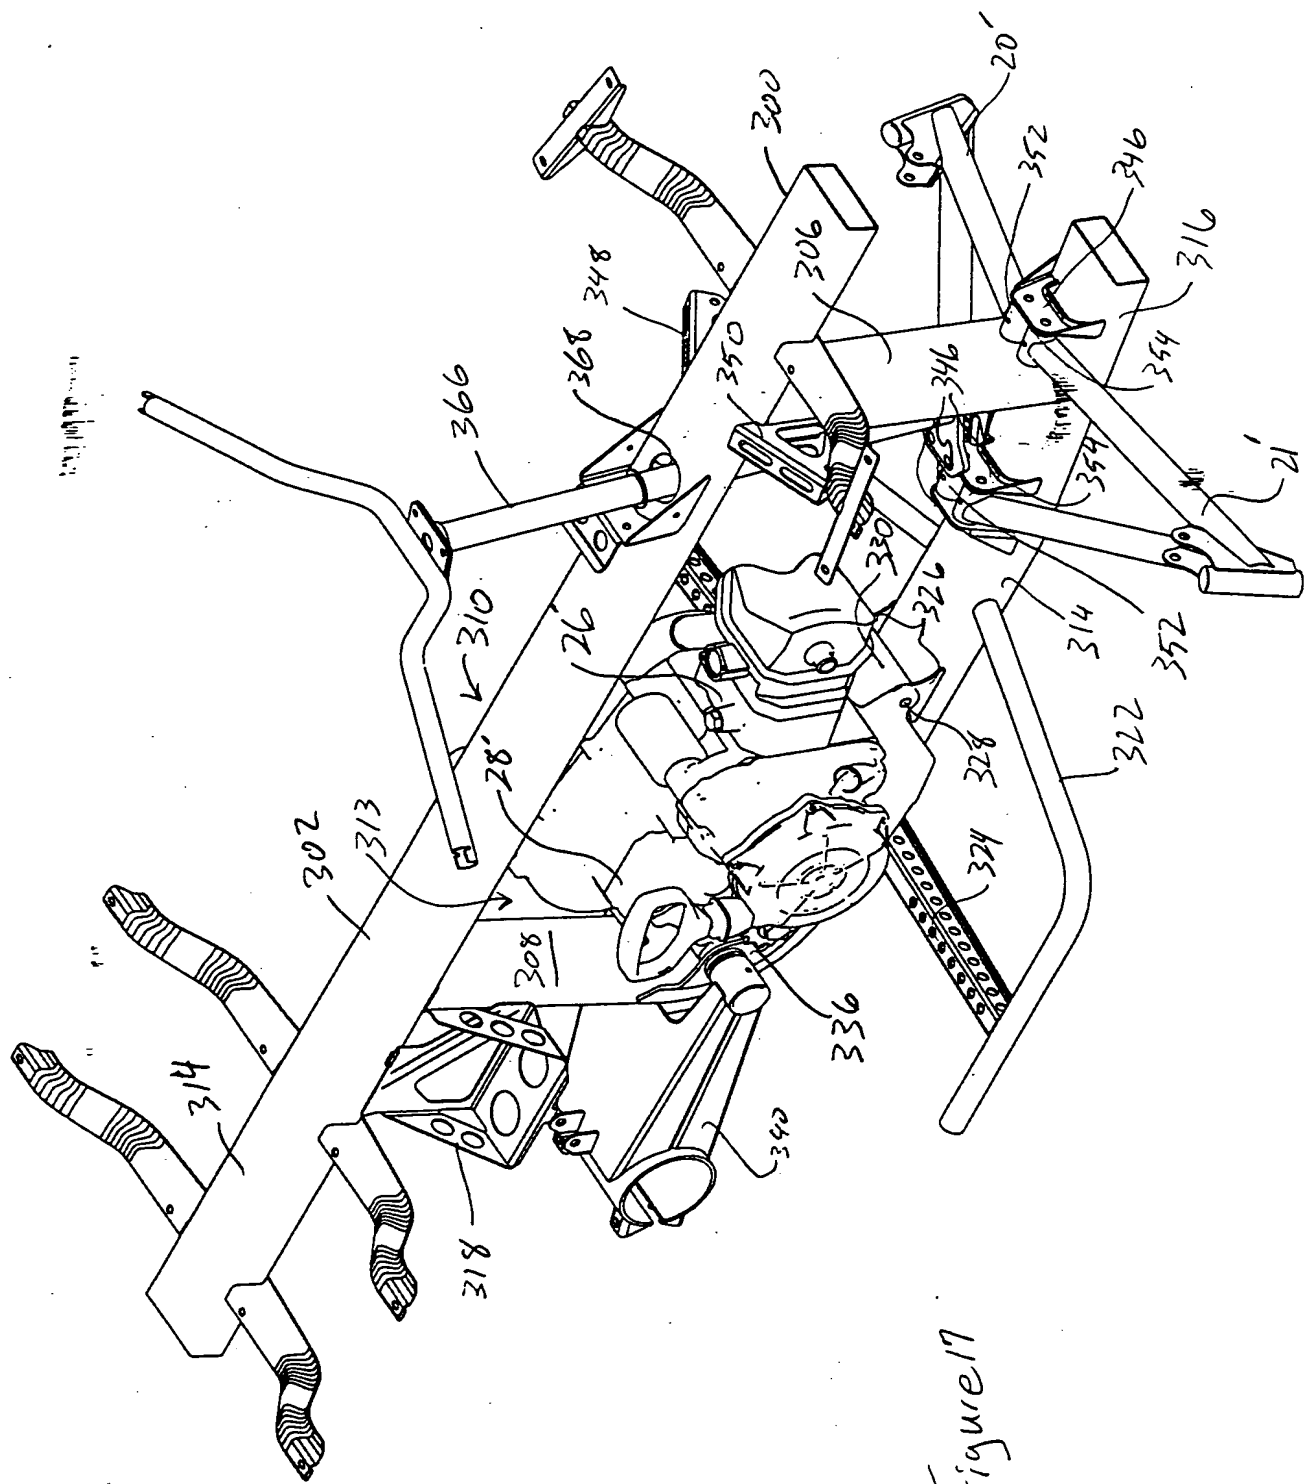


Figure 17

Figure 18A

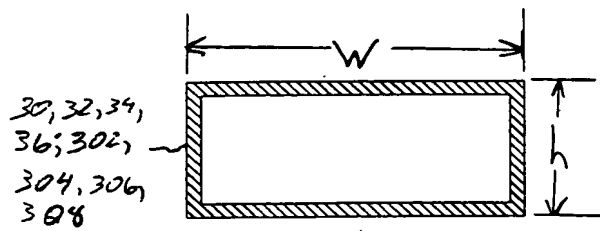


Figure 18B

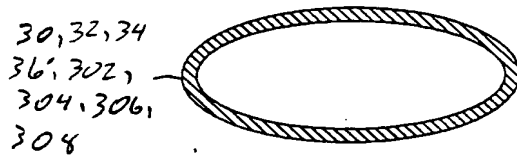


Figure 18C

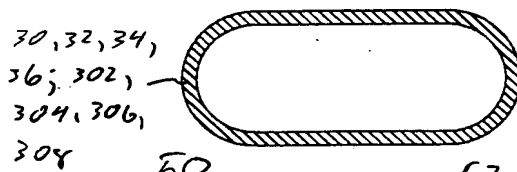


Figure 18D

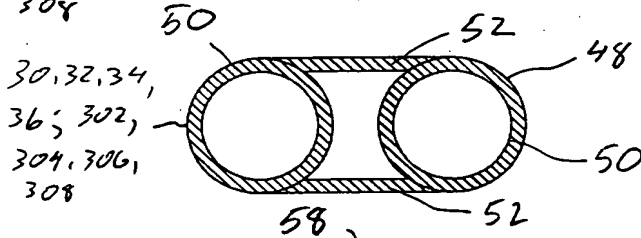


Figure 18E

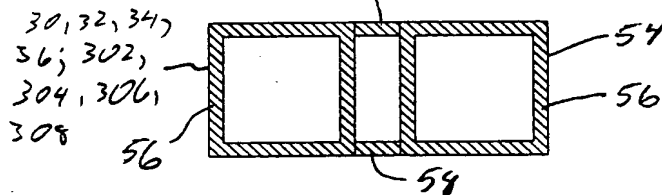


Figure 18F

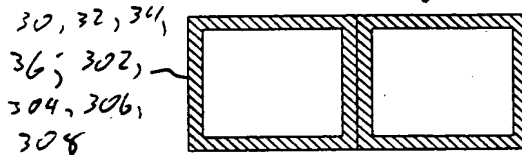
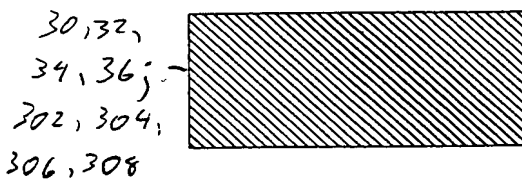


Figure 18G



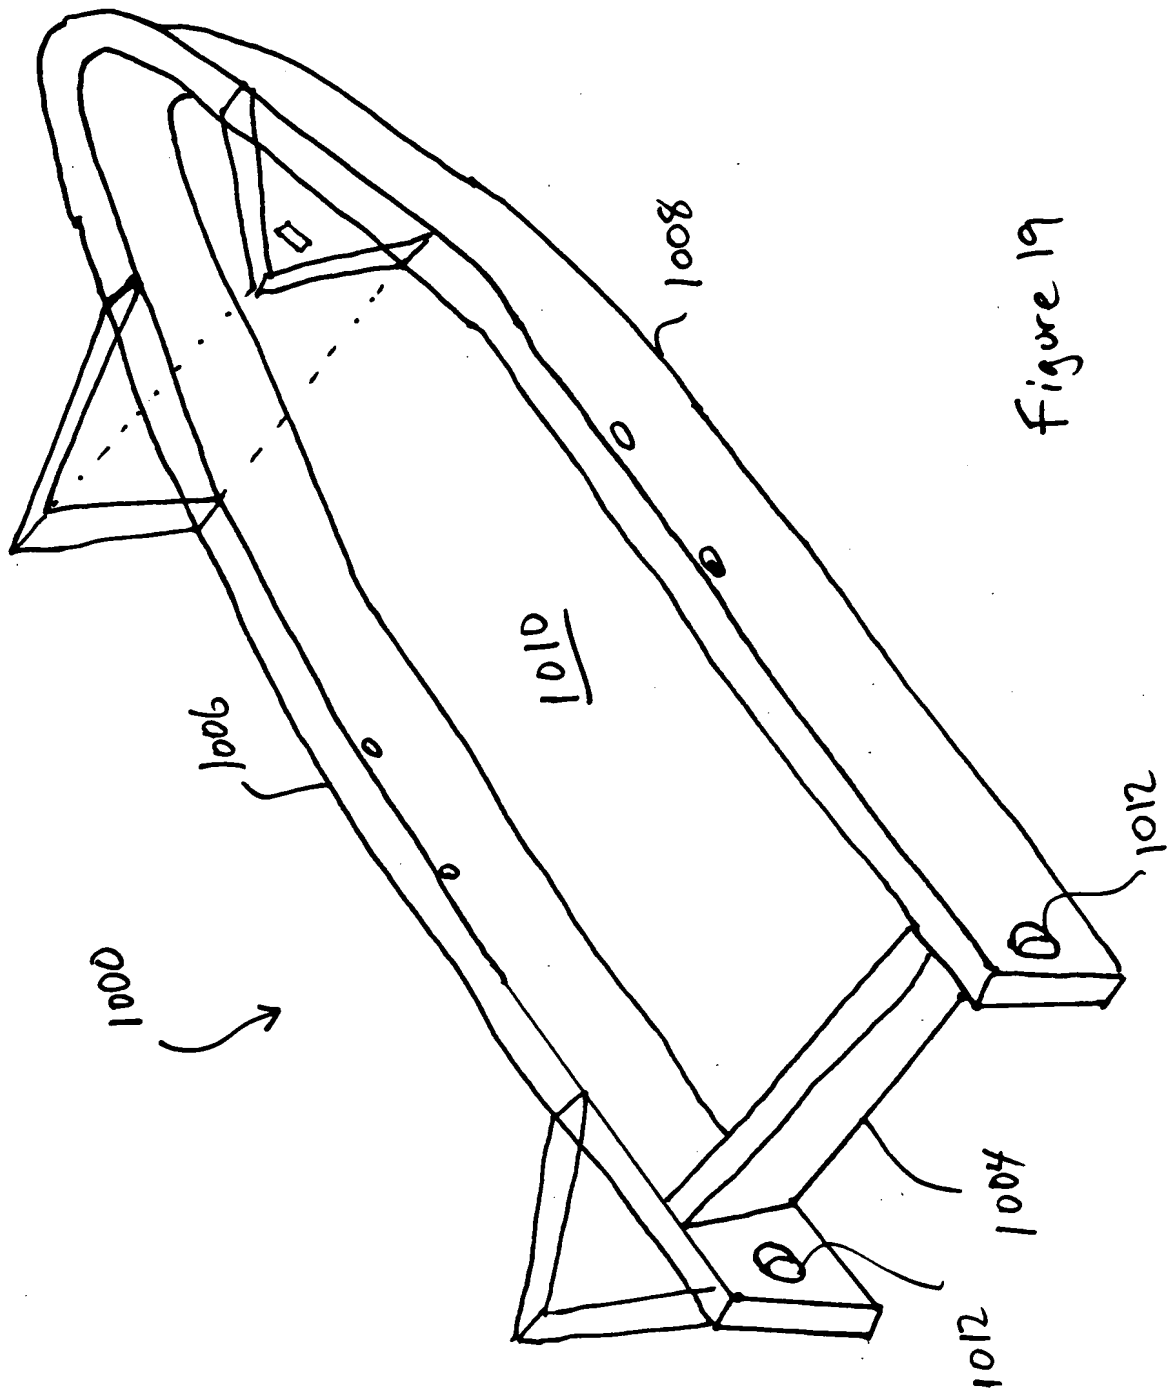


Figure 19